

Evidence of Performance

Single axis door and window hinges according to EN 1935 : 2002



Test Report

No. 13-000308-PR01
(PB-G02-03-en-01)

Client
WALA Sp. z o.o.
ul. Parkowa 16
43-365 Wilkowice
Poland

Product
Single axis triple door hinge

Designation
Door hinge, Type WALA with roll lifter

Performance-relevant product details

Hinge height:	186 mm;
Door hing material:	Aluminium;
Hinge pin material:	Nirosta / stainless steel;
Hinge pin diameter:	12 mm;
Roller diameter:	20 mm;
Overlap thickness:	3.5 mm;

Wartung
According the service manual of the hardware manufacturer

Special features
not specified

Basis


EN 1935 : 2002

Test standards:
EN 1935 : 2002

Corresponds to the national versions (e. g. DIN EN)

Test Report 13-000308-PR01
(PB-G02-03-de-01) dated
21 May 2013

Representation

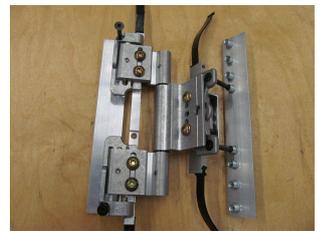

Instruction for use

This test report serves to demonstrate the requirements of hinges according to EN 1935 : 2002.

This test report is **not** a substitute for the EC Certificate of conformity. The conditions and requirements set out by EN 1935 : 2002 for the marking and evaluation of conformity of construction products shall be observed.

Validity

The data and results refer solely to the tested and described specimen. Classification remains valid as long as the product and the above basis remain unchanged. The results can be extrapolated under the manufacturer's own liability subject to observance of the relevant specifications set out by the applicable product standard. This test/evaluation does not allow any statement to be made on any further characteristics regarding performance and quality of the construction presented; in particular the effects of weathering and ageing were not taken into account.

Notes on publication

The **ift** Guidance Sheet "Advertising with **ift** test documents" applies. The cover sheet can be used as an abstract.

The report contains a total of 23 pages.

Results

Classification according to EN 1935 : 2002

Category of use	Durability	Mass of test element	Fire resistance	Safety	Corrosion resistance	Security	Hinge grade
4	7	7	0	1	4	1	14

ift Rosenheim

28.05.2013

Andreas Matschi, Dipl.-Ing. (FH)
Deputy Head of Testing Department
Building Components

Alexander Sauer, Dipl.-Ing. (FH)
Operating Product Officer
Building Components